



MCCP Dwell vs Gates

Net Gates are calculated by subtracting out gates from in gates by equipment size.
 Surplus indicates higher in-gates volumes were recorded than out-gates.

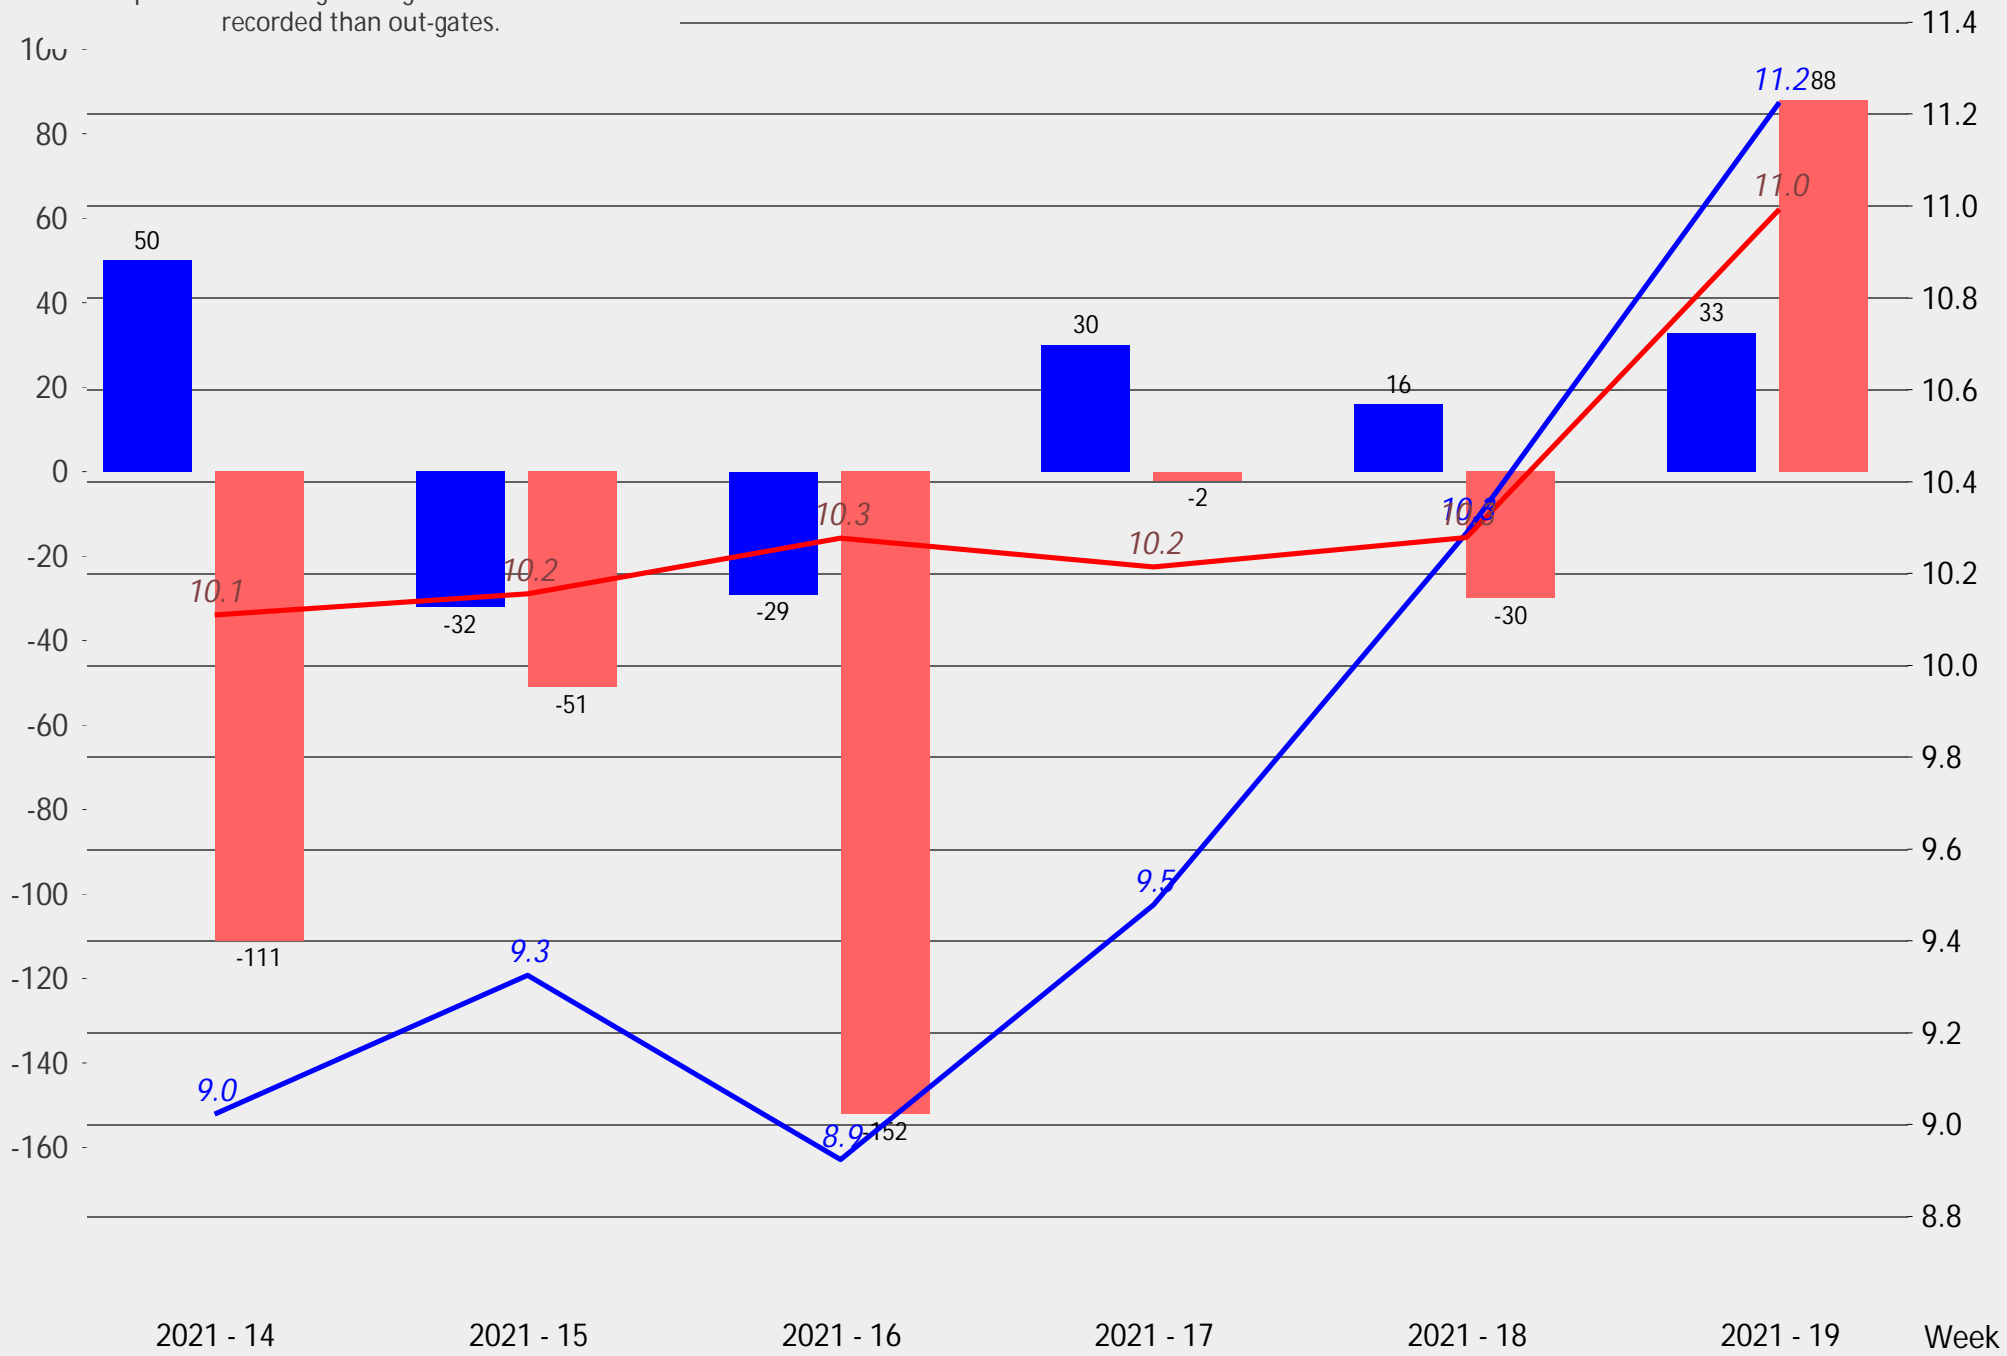


■ Net Gates 20CH
 ■ Net Gates 40/45CH
 — Pool Dwell - 40/45'
 — Pool Dwell - 20'

Memphis Dwell vs Gates

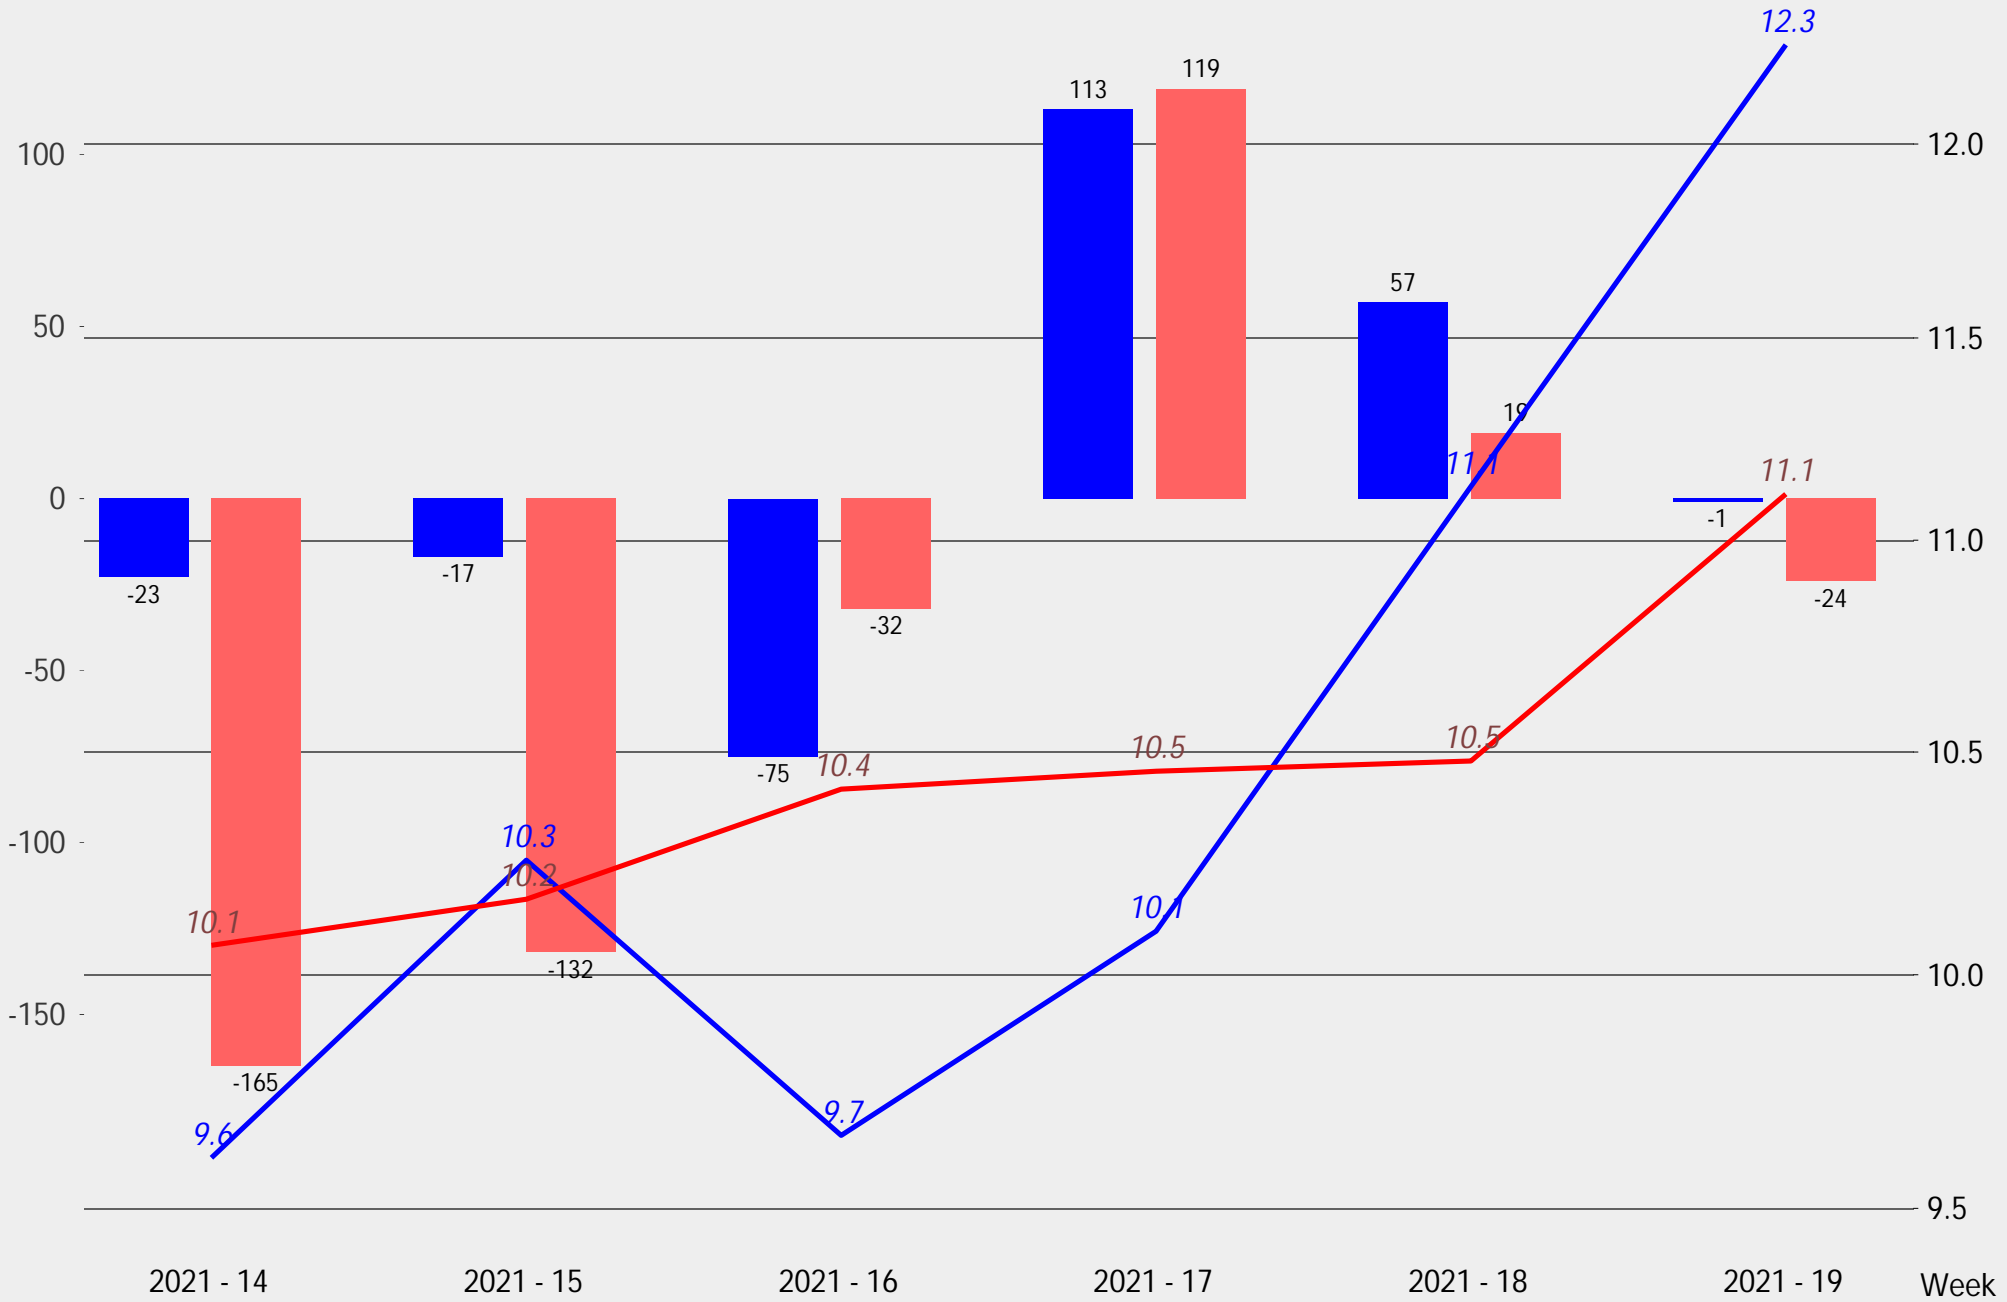


■ Net Gates 20CH
 ■ Net Gates 40/45CH
 — Memphis Dwell - 40/45'
 — Memphis Dwell - 20'

Nashville Dwell vs Gates

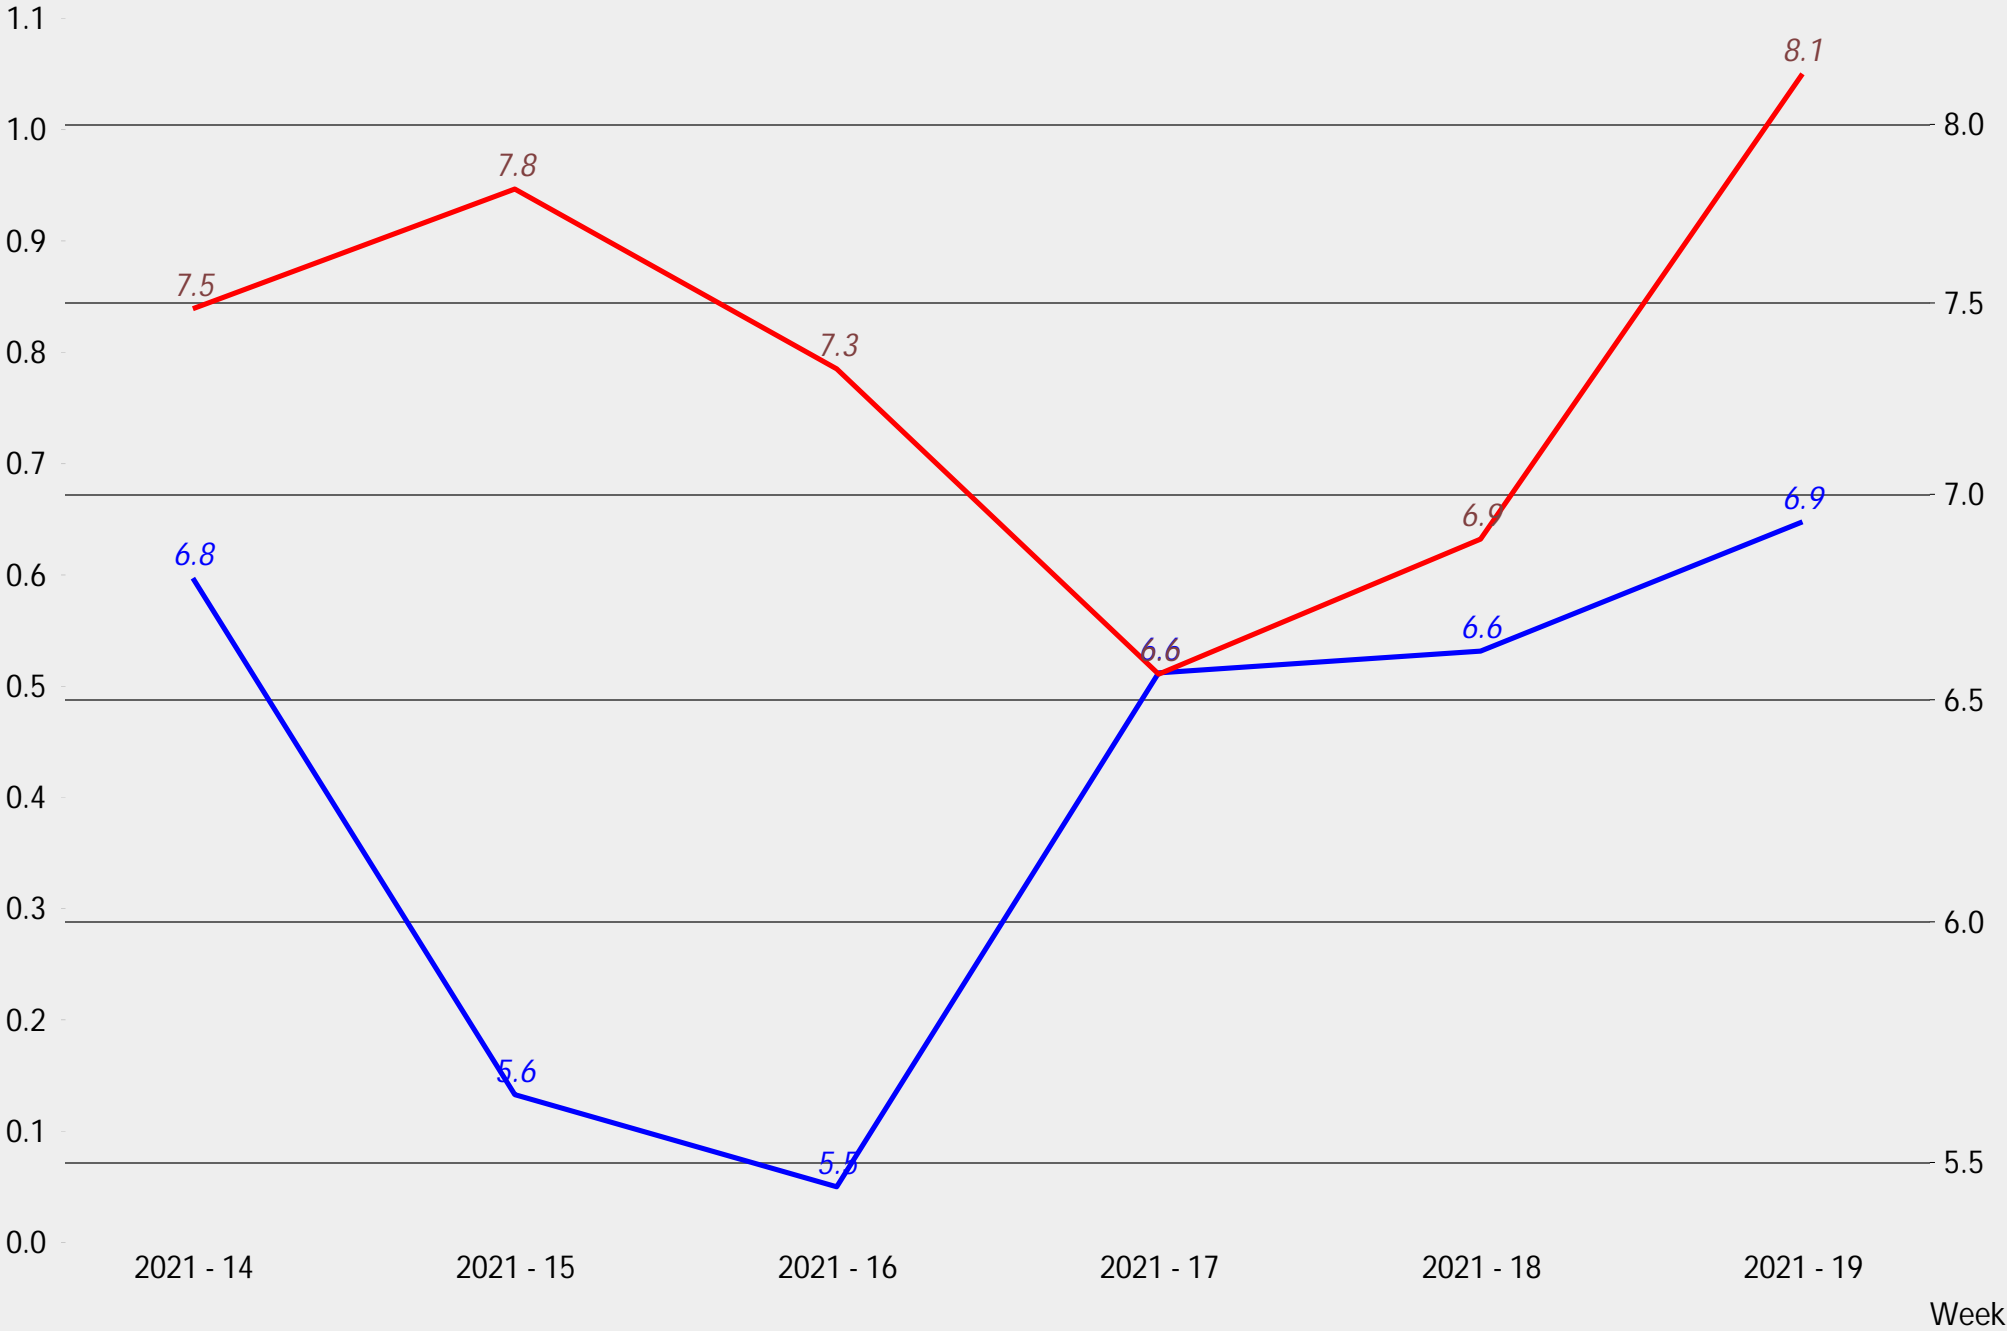

Net Gates 20CH Net Gates 40/45CH Nashville Dwell - 40/45' Nashville Dwell - 20'

Huntsville Dwell vs Gates

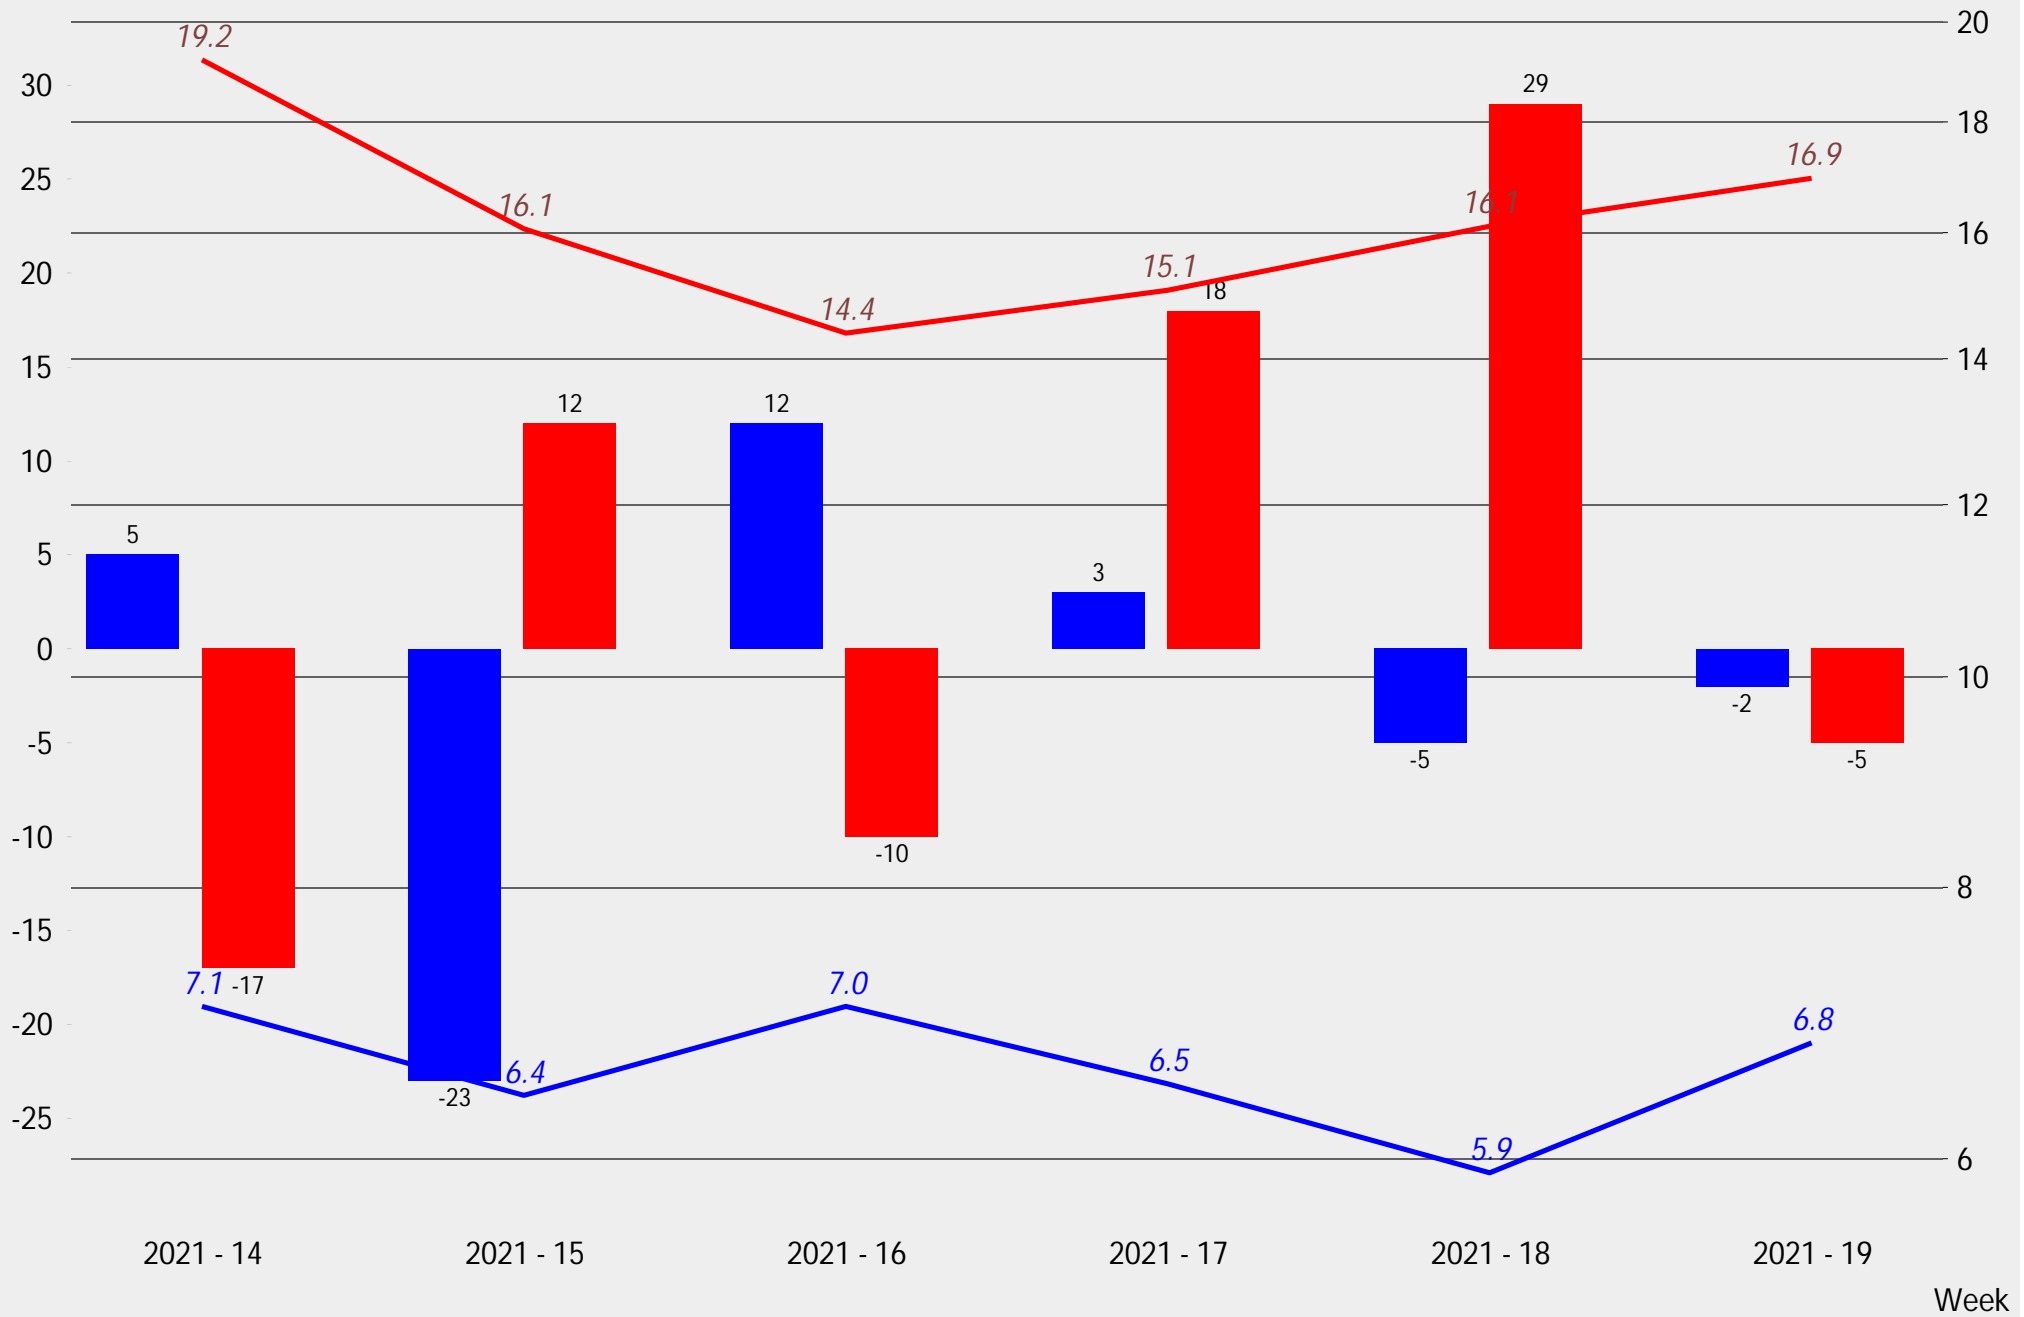

Net Gates 20CH

Net Gates 40/45CH


Huntsville Dwell - 40/45'

Huntsville Dwell - 20'

Week

No data to display

Charlotte Dwell vs Gates

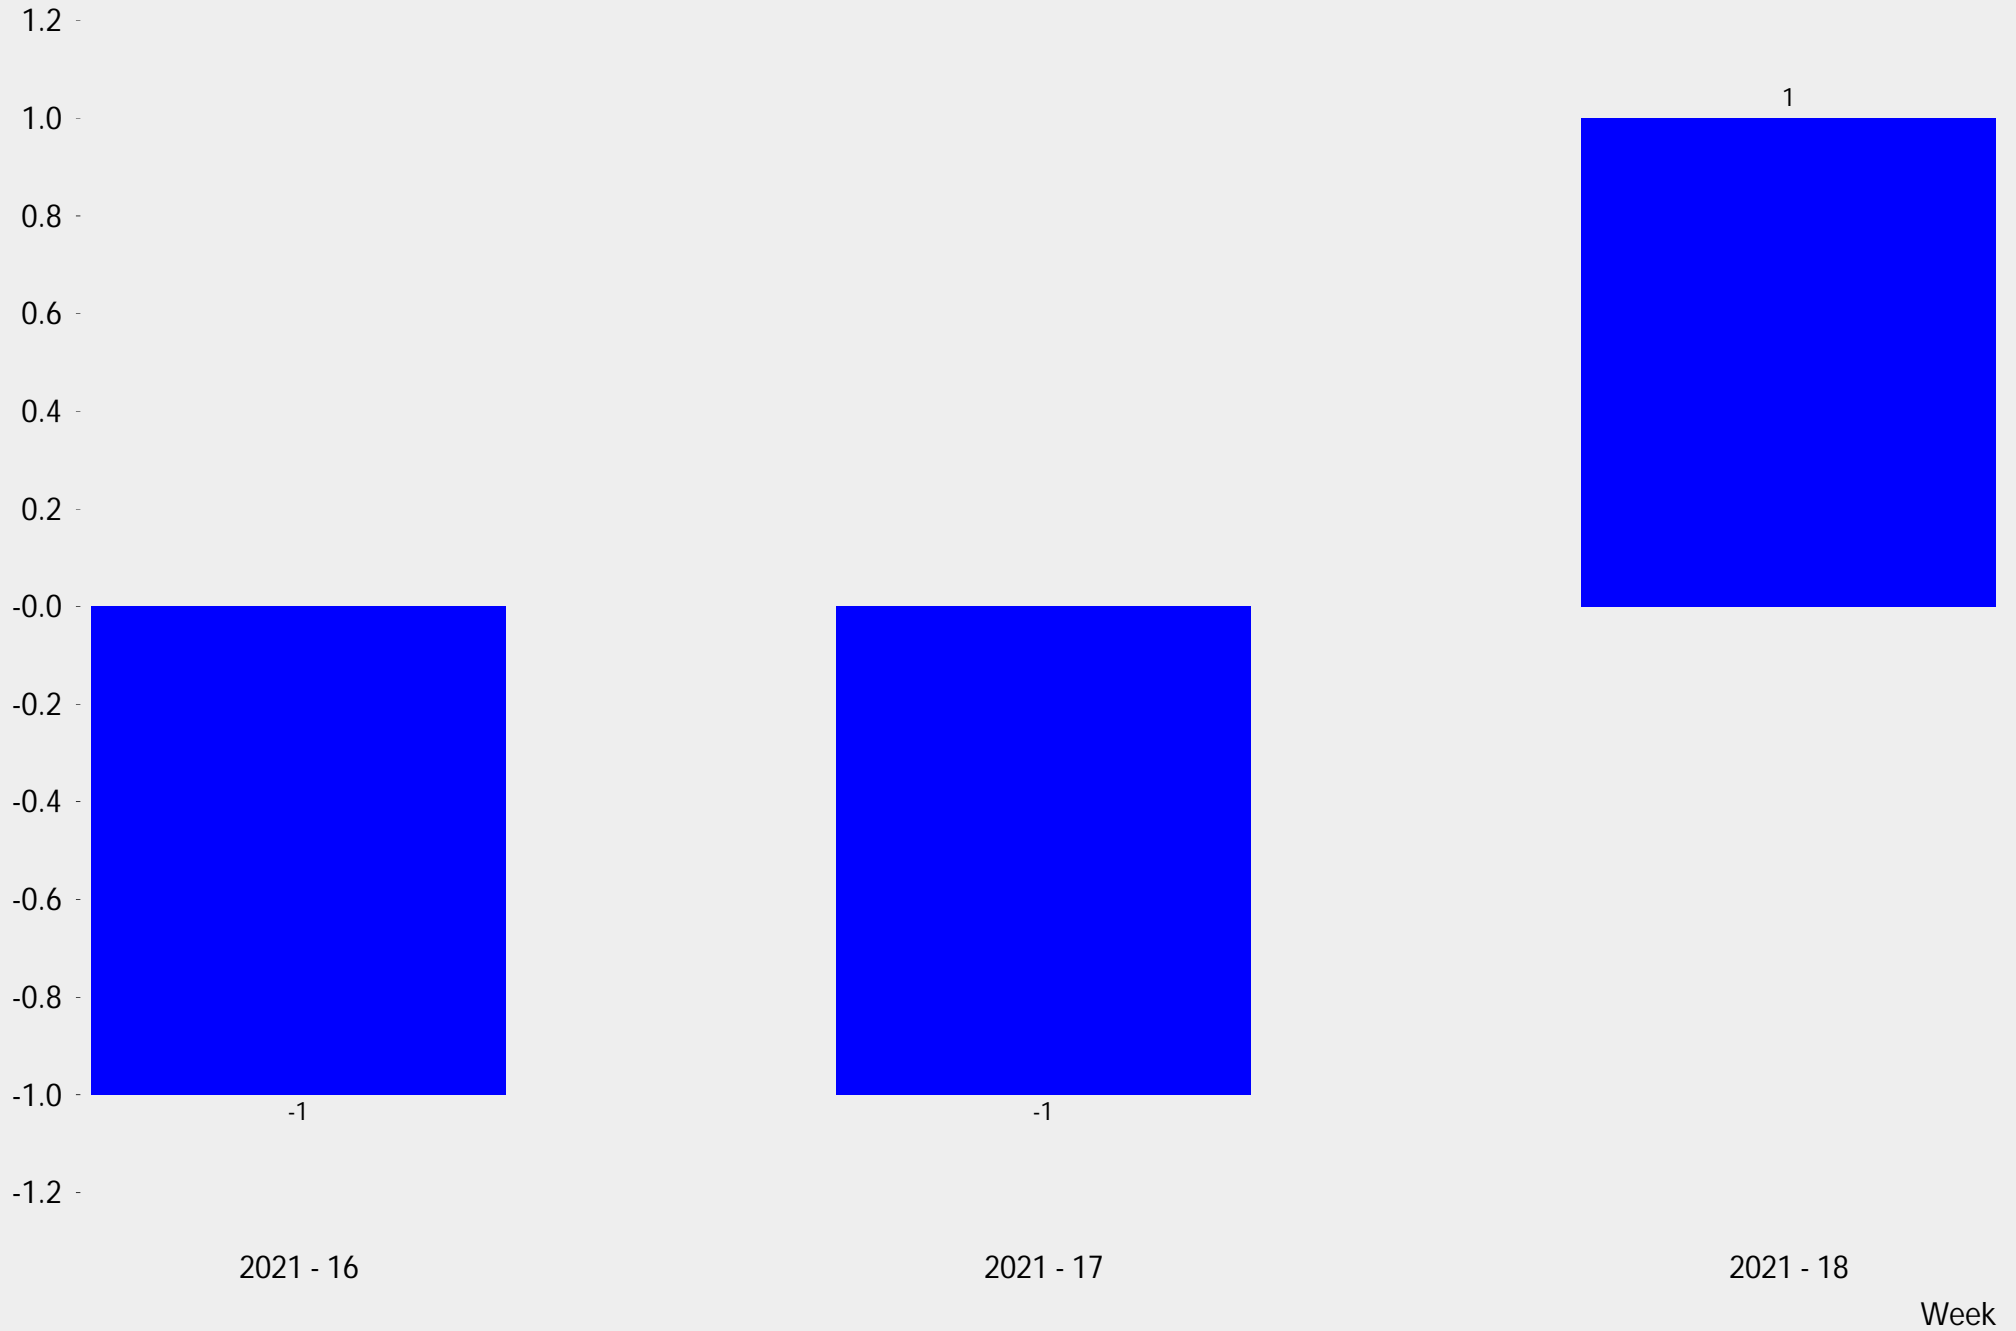

Net Gates 20CH Net Gates 40/45CH Charlotte Dwell - 40/45' Charlotte Dwell - 20'

No data to display

No data to display

No data to display